






Jarhead Installation Instructions

Important safety instructions - save these instructions in a readily accessible location.

-  **WARNING: CANCER AND REPRODUCTIVE HARM** - [WWW.P65WARNINGS.CA.GOV](http://www.P65WARNINGS.CA.GOV)
-  **WARNING** Never use with gasoline or highly flammable liquids.

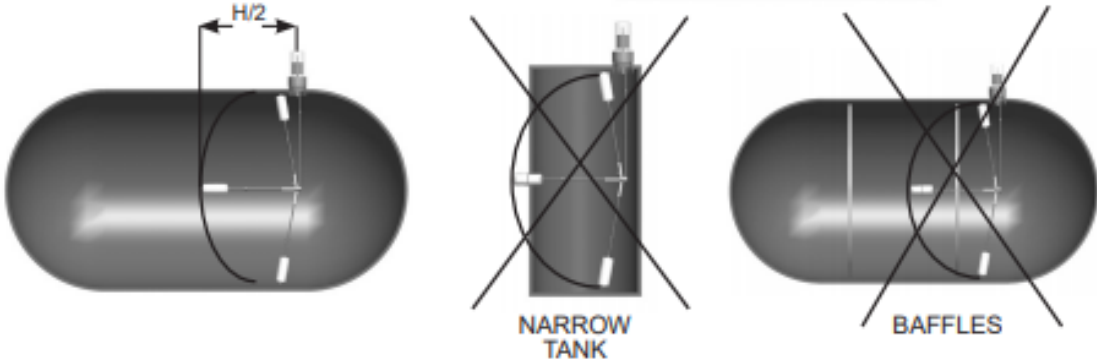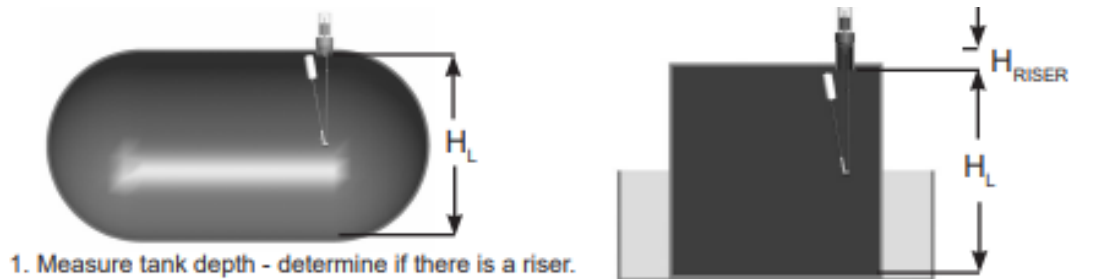


3. Use hex wrench to loosen the set screw in the support arm's collar.

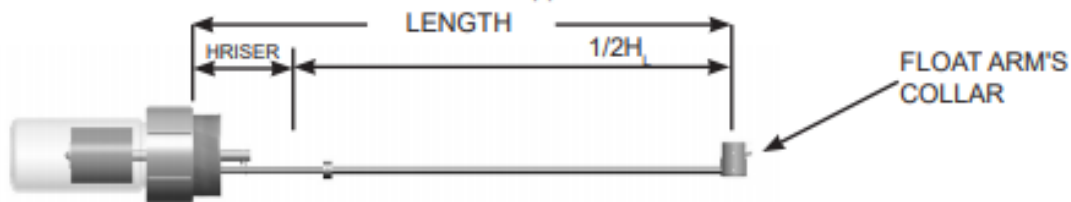

- 4. Extend the support arm to the correct length, $H_{riser} + H_L/2$.
- 5. While maintaining the length from step 4, align the float arm in line with the spring loaded shaft. (This will help prevent twists and tangles in the chain.) Tighten the set screw to lock the position of the support arm.
- 6. Use hex wrench to loosen the set screws in the float arm's collar.

Jarhead Installation Instructions continued...

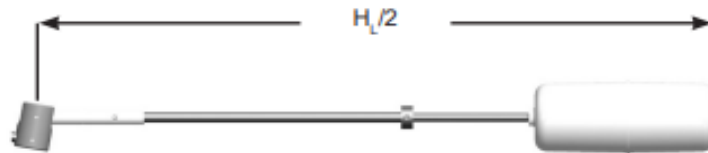


7. Extend the float arm to the correct length $H_L/2$.
8. Tighten the float arm's set screw to lock the position of the float arm.
9. Remove and **KEEP** the chain eyelet.




10. Swing the float arm so it lays flat and in-line with the support arm.



11. Pull the chain until the orange indicator is completely hidden by the printing on the sight glass. Hold the spring loaded shaft in that position.

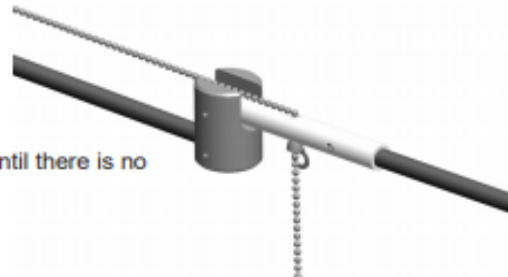

12. Pull the chain through the hole on the float arm until there is no slack and then reattach the eyelet from step 9.

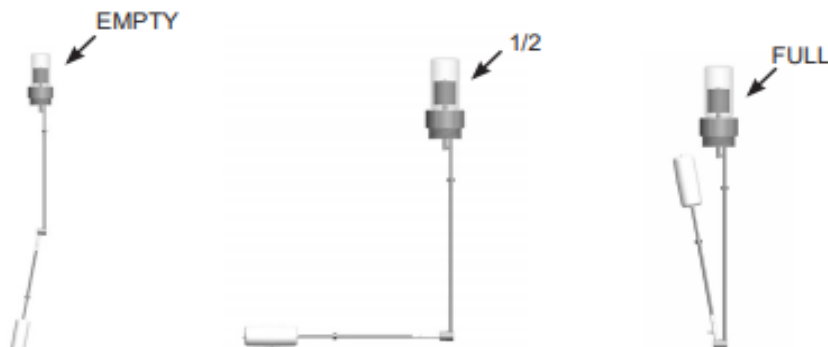


13. Verify proper function. If it's not working properly and if the orange indicator reads incorrectly, adjust the position of the eyelet. If repositioning the eyelet doesn't work, verify the length of the arms and overall length is correct.

Jarhead Installation Instructions continued.....



14. Remove sight glass. Remove threaded adapter from support and float assembly.
15. If a thread sealant is required, apply appropriate sealer to male threads of adapter.
16. Screw adapter in to tank bung. DO NOT OVERTIGHTEN.
17. Reinstall assembly into adapter. If you align the float arm in step 5, you can use the slot in the top of the disk as a guide to assure the float arm clears the side of the tank and/or baffles.
18. Reinstall sight glass.

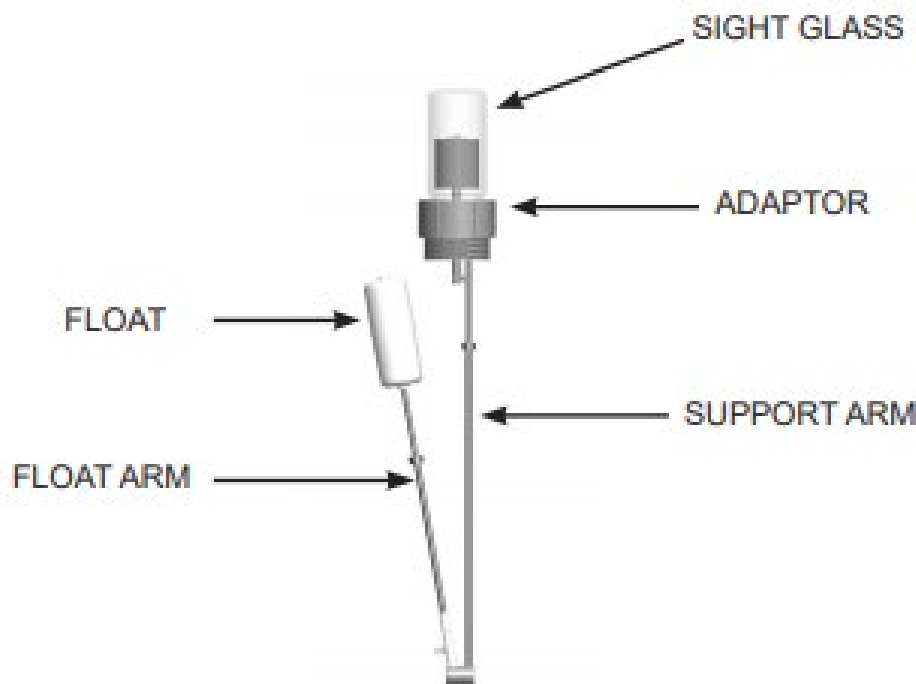



Jarhead Installation Instructions continued...

TESTING / MAINTENANCE / INSPECTION



Daily

- Confirm sight glass is not damaged.



Quarterly

- Remove gauge from tank and confirm float is not touching baffles or sides of tank.
- Verify chain is free of twists or tangles.

- Apply city, state, or federal testing regulations as appropriate.

***ANY TEST / INSPECTION
FAILURE REQUIRES IMMEDIATE
EQUIPMENT REPLACEMENT OR
REMOVAL FROM SERVICE.***

MADE IN THE USA

Jarhead Installation Instructions continued...



ALWAYS ADHERE TO INSTALLATION / USAGE INSTRUCTIONS AND WARNINGS.

Improper use may result in injury, damage, or hazardous spill.



GENERAL WARNINGS / INSTRUCTIONS PERTAINING TO A RISK OF FIRE, ELECTRIC SHOCK OR INJURY TO PERSONS:



- Use of equipment is at individuals' own risk.
- Always abide and adhere to city, state, and federal regulations regarding use and installation of monitoring equipment.
- Always follow the product manufacturer's installation and maintenance instructions.



- Always turn off all power to monitor during maintenance activities.
- Always replace or remove from service damaged equipment immediately.



- Always report leaks / spills / accidents to appropriate authorities.



- Always wear appropriate safety equipment during maintenance and inspection activities.



- Always have appropriate fire extinguishing equipment within 5 ft / 1.5 m of tanks.
- Always use Teflon® tape or appropriate thread sealant.



- The tank contents are the sole responsibility of the tank owner.



- Never allow waste product to touch eyes or skin.



- Never install monitors outdoors without proper protection from the elements.



- Never use on below ground storage tanks.



- Never exceed the maximum milliamps specified in manufacturer's installation and maintenance instructions.

- Never solely rely on this product; there is no substitute for human supervision.

- Never to be used as a component of any automatically controlled pump transfer system.